

1

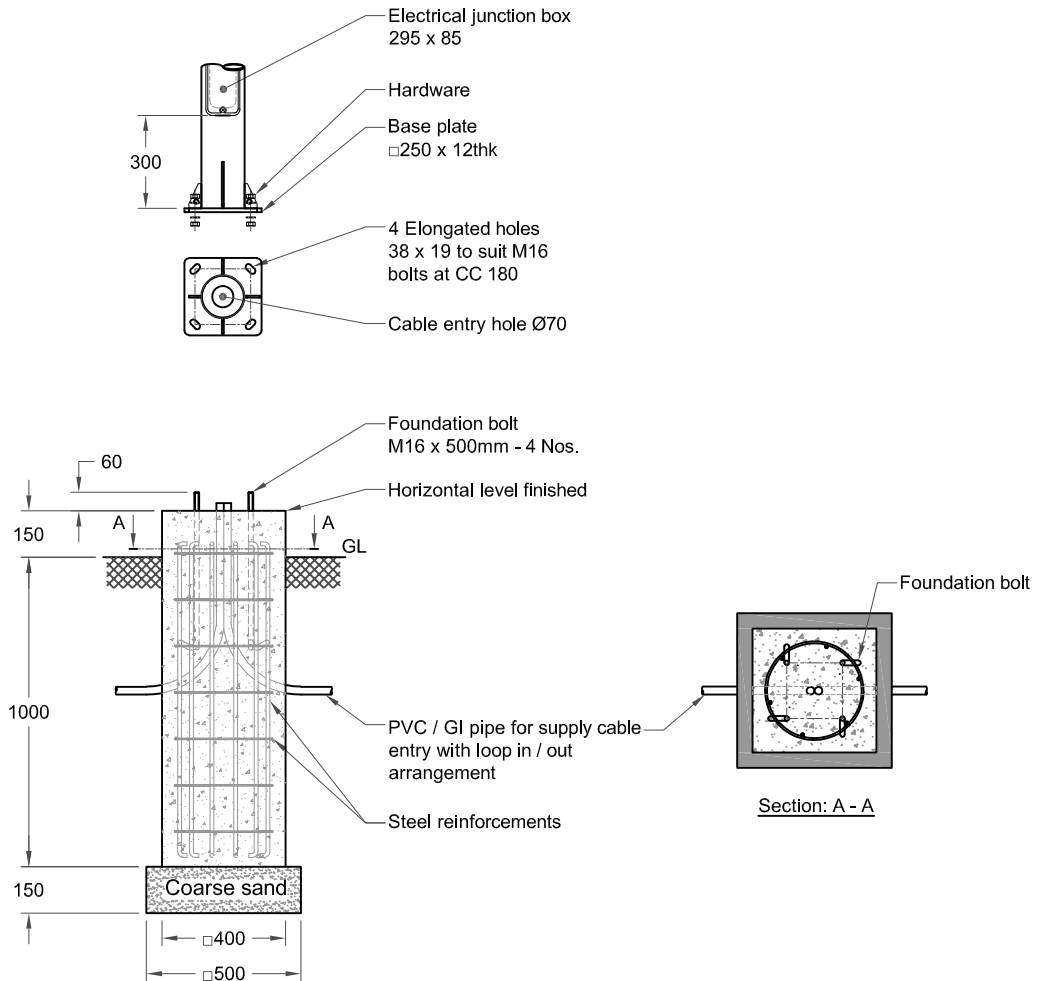
2 IF IN DOUBT ASK. DO NOT SCALE.

3

4

DWG. No. : KP-DFD-094
SHEET No. : 1 of 1

ALL DIMENSIONS ARE IN mm

**Note :**

- Typical foundation drawing for standard soil condition.
- Parameters considered in RCC foundation design :
Load bearing capacity of soil (LBC) : 10 Mt/m² (Minimum)
Basic wind speed : 50 m/s
Grade of steel reinforcement : Fe 415
Grade of foundation bolt : 4.6
- Height of foundation above ground level (150mm) may be revised to suit the site conditions especially considering the expected water level stagnation.
- Template supplied is suggested to be used for locating the CC of foundation bolts.
- 4 Nos. of foundation bolt have to be oriented (located), while casting the foundation such that the door of the electrical junction box faces the required direction.
- PVC / GI pipe for entry of supply cable and the materials required for foundation are not scope of our supply.

REV. No.	REVISION DETAILS	DATE	REVISED	CHD	APPD
----------	------------------	------	---------	-----	------

DRAWN BASKAR	CHECKED	APPROVED	DATE 29-05-18	SCALE 1 : 25	MATERIAL -	Z:\KP\005.FOUNDATION DETAILS\KP - DFD - 094\REV 00.dwg
K-LITE INDUSTRIES CHENNAI - 600 058						DETAILED FOUNDATION DRAWING FOR KP - 48 □250 x 12 (FOUNDATION BOLT M16 x 500)
						DRG. NO. KP-DFD-094 REV 00 SHEET 1 of 1

1

2

3

4