


DWG. CODE : KP-DFD-021
SHEET No. : 1 of 1

ALL DIMENSIONS ARE IN mm

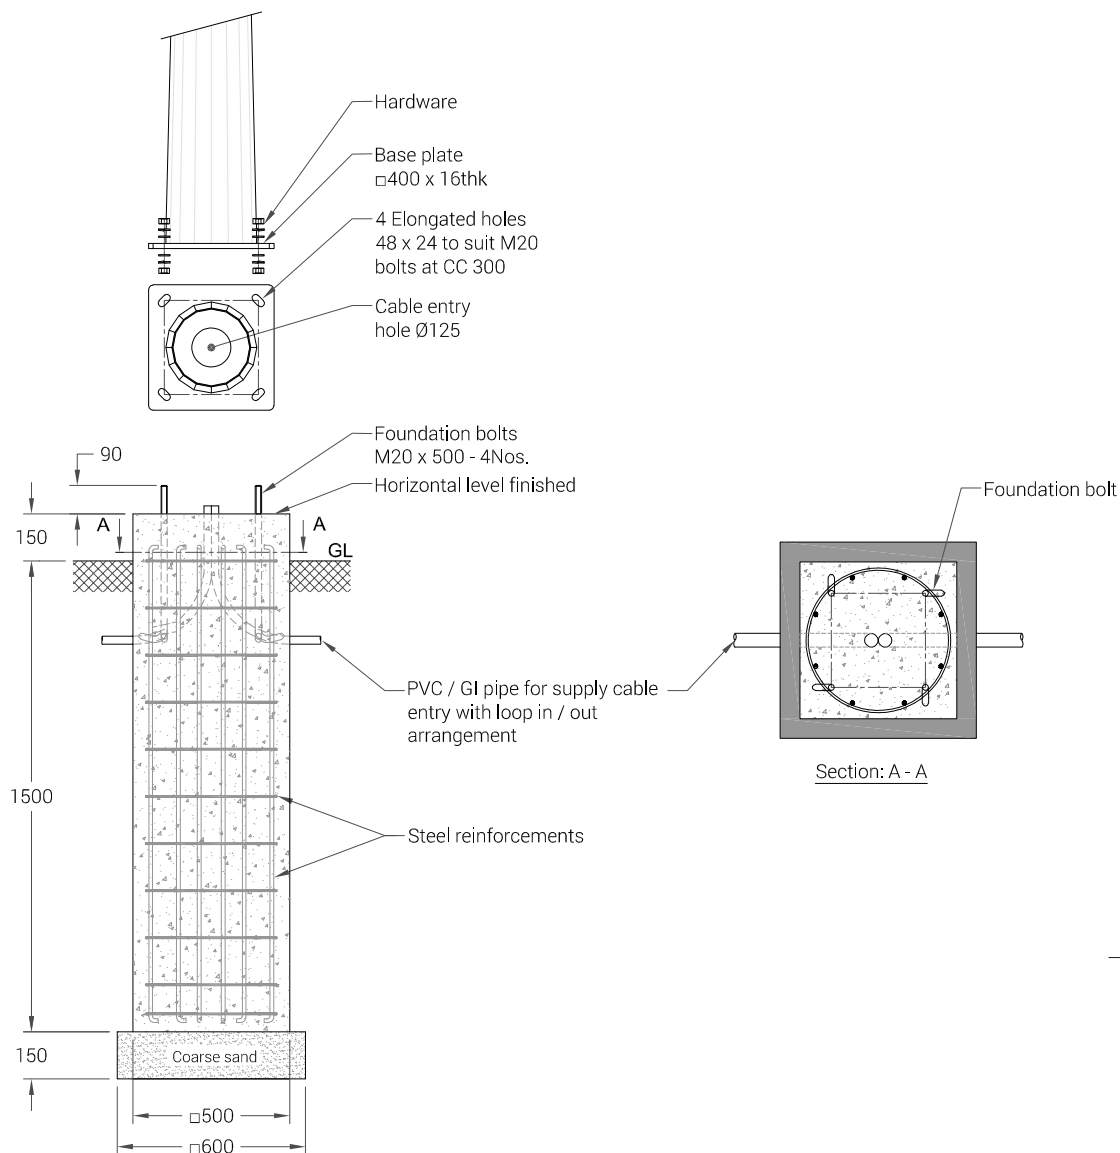

Note :

1. Typical foundation drawing. Contact local site engineer for detailed drawing
2. Parameters considered in RCC foundation design :
Load bearing capacity of soil (LBC) : 10 Mt/m² (Minimum)
Grade of steel reinforcement : Fe 415
Grade of foundation bolt : 4.6
3. Height of foundation above ground level (150mm) may be revised to suit the site conditions especially considering the expected water level stagnation.
4. Template supplied is suggested to be used for locating the CC of foundation bolts.
5. 4 Nos. of foundation bolts have to be oriented (located), while casting the foundation such that the door of the electrical junction box faces the required direction.
6. PVC / GI pipe for entry of supply cable and the materials required for foundation are not scope of our supply.

02.	DESIGN REVISED	16-11-24	SANKAR		
01.	DESIGN REVISED	19-03-18	SATHISH		
REV. No.	REVISION DETAILS	DATE	REVISED	CHD	APPD

DRAWN THIRUPATHI	CHECKED	APPROVED	DATE 05-03-15	SCALE 1 : 25	MATERIAL -	Y:\KP\005.FOUNDATION DETAILS\KP-DFD-021 (KP-20)\KP-DFD-021 (KP-20) , REV 02.dwg				
K-LITE		K-LITE INDUSTRIES PRIVATE LIMITED CHENNAI-600 058				DETAILED FOUNDATION DRAWING FOR KP - 20 □400 x 16 (Foundation Bolt M20 x 500)				
				DRG. CODE. KP-DFD-021		REV 02	SHEET 1 of 1			